

SEM310 USER GUIDE

SMART IN HEAD MOUNTED UNIVERSAL TRANSMITTER TWO WIRE (4 to 20) mA OUTPUT





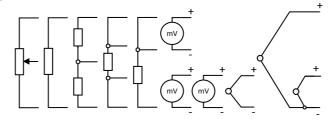



Important - Please read this document before any installing

Every effort has been taken to ensure the accuracy of this document, however we do not accept responsibility for damage, injury, loss or expense resulting from errors and omissions, and we reserve the right of amendment without notice.



IMPORTANT - CE & SAFETY REQUIREMENTS

Product must be mounted inside a suitable enclosure providing environmental protection to IP65 or greater.

To maintain CE EMC requirements, input wires must be less than 3 metres.

The product contains no serviceable parts, or internal adjustments. No attempt must be made to repair this product. Faulty units must be returned to supplier for repair.

This product must be installed by a qualified person. All electrical wiring must be carried out in accordance with the appropriate regulations for the place of installation.

Before attempting any electrical connection work, please ensure all supplies are switched off.

ABSOLUTE MAXIMUM CONDITIONS (To exceed may cause damage to the unit):-

Current with over voltage

± 100 mA

Input Voltage Ambient

Temperature (-40 to 85) °C Humidity (10 to 95) % RH (Non condensing)

± 30 V dc (Protected for over voltage and reverse connection)

Product Information

Example of Type and Range shown below

TYPE: Pt100 RANGE:0 - 100°C

SEM310 HART ® Ser.No:123456 - 0001



Conditions for use




The SEM310 temperature transmitter should be mounted in an enclosure with a minimum IP rating of IP54. The enclosure should be specified to operate in the ambient temperature range of (-40 to 85) °C.

Maintenance

The SEM310 apparatus contains no user serviceable adjustable, replaceable parts. No attempt should be made to repair a SEM310 device, all units must be returned to the manufacturer for repair or replacement. Attempted service or replacement of parts may invalidate the warranty of the SEM310.

Mechanical Detail



The SEM310 is mounted using two holes, on standard 33 mm fixing centres and will fit a DIN standard termination head. The SEM310 must be installed with adequate protection from moisture and corrosive atmospheres. Refer to conditions for use section of this user guide for information on enclosure IP rating.

Care must be taken to ensure the SEM310 is located to ensure the ambient temperature does not exceed the specified operating temperature.

A 6.3 mm hole is provided in the centre of the transmitter for sensor wires.

The sensor wires may also be fed on the outside of the transmitter.

Installation



For SEM310 specification please refer to product data sheet. Installation is normally performed in the following order. If the SEM310 has been purchased as part of a probe assembly ,steps (1 to 3) will have been completed. The user may wish to reconfigure the transmitter range, in this instance the SEM310 range can be changed on a completed probe assembly by following step 1.

- 1. Configuration
- 2. Mount Transmitter into head
- 3. Wire Sensor
- 4. Install Assembly
- 5. Wire (4 to 20) mA Loop

1. Configuration



Note: - The SEM310 can be configured whilst connected and powered, but a portable battery powered computer must be used to avoid the effects of ground loops if the (4 to 20) mA loop is grounded. This may damage the SEM310.



Once software is installed remove protection cover from device port, plug in USB Lead to device ports and connect PC using USB cable.



"Field Product – In Head TX" menu.

For further information on configuration please open the help menu on the product configuration screen.

On completion of configuration remove USB cable and replace protective cover over socket.

In USBSpeedLink software, select Model type from

Factory default setting Sensor PT100 range (0 to 100) °C,

The main configuration is performed using the USB interface. The following parameters may be configured using the powerful USBSpeed link software tool, which also provide operator diagnostics.

The following functions apply:-

SENSOR

Sensor type mV, Dual mV, ohms, slide wire, thermocouple, dual thermocouple, RTD, dual RTD (2 wire).

Sensor wire (ohms and rtd ranges only) 2, 3, or 4 wire.

Thermocouple type Download from USBspeedlink expanding library, common type K,J,T,E,R,S,N,B,U,G,C,D.

Thermocouple CJ Fixed or Auto.

RTD type Download from USBspeedlink expanding library, common type PT100, PT1000, PT500, Ni, CU, KTY series.

Sensor(s) Fail Value on sensor A, (sensor B) fail.

Sensor Pre-set Override sensor signal with pre-set value, primary function diagnostics.

PROCESS

Scaling Scale sensor signal to PV, options - Off, Two point scaling or (4 to 22) step profile.

Units Set PV units

mA Output

Damping Profile out damping (0 to 32) seconds.
Range Range (PV units) For (4 to 20) mA output.

Fix Loop Current Fix loop current to pre-set value (Note resets on power up) . Primary use Diagnostics.

Hart Multi_drop Detects HART address > 0.

Set Max mA Set the maximum output current (20 to 23)mA. Set min mA Set minimum output current (3.5 to 4.0) mA.

Trim Read set and reset (4 and 20) mA Trim values. (as for Hart DAC trim).

DIAGNOSTICS

Power ups Number of power ups from manufacture.

Min Max PV Minimum and maximum process variable value during operation with reset.

Operating times From manufacture and calibration. Calibration time is resettable.

Calibration Store Date, operator and certificate number.

Save Data Save transducer data to text file.

DIAGNOSTCS LOG

Type 150 point non volatile Process Variable log, with power off indication and sensor fail (not time stamped).

Rates User set log periods seconds 5, 15, 30 minutes 1, 2, 5, 10, 20, 30, or 60.

Backup Save log to PC in CSV style format (using semi colon delimiter) for easy export to text editor or spreadsheet.

HART DATA

Edit Tag Number and Date, Description, Message, Long Tag, Final Assembly Number, Transducer serial number.

Set Poll address, write protect.
Reset Configuration counter.

HART INFORMATION/FLAGS

Read Manufacturers ID, Short ID, Hart Revision, Device Revision, Software Revision, Unique ID, No Preambles, Max No Variables,

Configuration Change register, Extd device status, Extd Manufacturers ID, Extd Distributers ID, Device status flags, Extd device status

flags.

PROCESS DATA

Data Live data for sensor (TV) ,pre-scaling, post scaling (PV), Untrimmed mA output, Actual mA output, % output signal and device ambient

temperature (SV) (cold junction).

Diagnostics Sensor wire error detect (not supported in mV mode), Loop power detect.

SEM310 Hart Interface provides the user with the following functions:

Universal Command All universal commands are supported.

Common Practice commands 34 Write Damping Value

35 Write Range Values,
40 Enter/Exit Fixed Current Mode
41 Perform Device Self-Test
42 Perform Master Reset
44 Set (Trim) PV Zero

45 Trim DAC Zero 46 Trim DAC Gain


49 Write PV transducer number

59 Write Number Of Response Preambles

2. Mount Transmitter into Head

The SEM310 is mounted using two holes, on standard 33 mm fixing centres and will fit a DIN standard termination head. The SEM310 must be installed with adequate protection from moisture and corrosive atmospheres. Refer to conditions for use section of this user guide for information on enclosure IP rating. A centre hole is provided in the SEM310 case, this allows for sensor wire to enter wiring section through the SEM310 body.

3. Sensor Connection

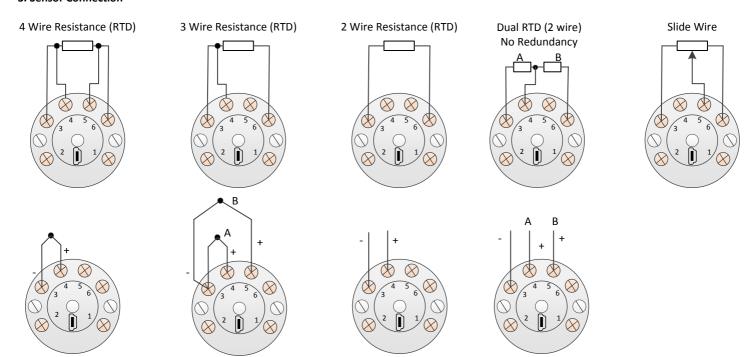

4. Install assembly

Thermocouple


Care must be taken to ensure the SEM310 is located to ensure the ambient temperature does not exceed the specified operating temperature

m۷

Dual mV

5. Wire (4 to 20) mA Loop

Ensure all other aspects of the installation comply with the requirements of this document. The (4 to 20) mA loop is connected as follows:-

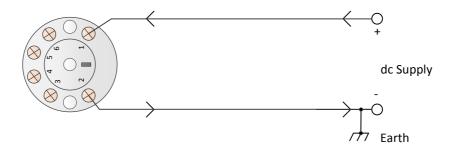

Additional Information

EMC BS EN 61326-1

(Sensor wires maximum length 3 metres to comply.)

Dual Thermocouple

Enclosure Colour Black